
Project Name **LEDALITE Vectra** Spec Type Recessed Notes 1'x4' 1 T5 mesoOptics® **RESPONSE**


Order Guide Some combinations of product options may not be available. Consult factory for assistance with your specification.

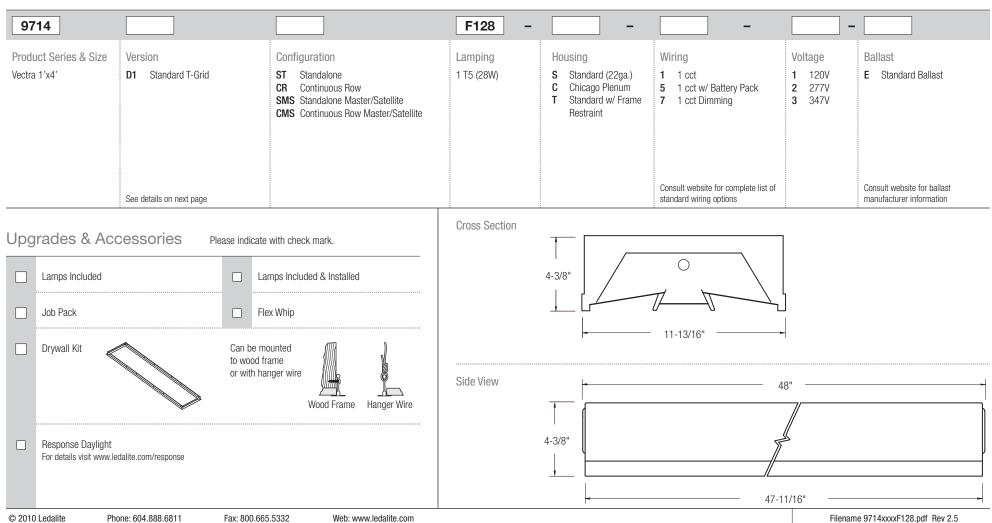

altwave,

Vectra

Recessed	
1'x4'	
1 T5	



Photometry

Report Summary

 Report #
 9900319
 Spacing Criteria
 1.3 @ 0° along


 Filename
 9714D1F128.ies
 1.3 @ 90° across

 Efficiency
 66.9%

Meets RP-1-04 recommendations for VDT-Normal spaces

Candela Distribution

Vertical Angle	0	Hori 22.5	Zonal Lumens			
0	813	813	813	813	813	
5	808	810	816	820	823	79
15	778	798	833	865	880	236
25	732	769	828	851	846	371
35	652	683	675	635	609	409
45	521	506	446	408	392	350
55	338	313	273	258	251	256
65	171	167	154	150	145	156
75	58	67	66	64	61	70
85	6	12	12	12	11	15
90	0	0	0	0	0	



Coefficients of Utilization (%)

Ceiling: Wall:	70	50	0 30	10	70	70 50	30	50	50 30	10	0 0
0 RCR	79	79	79	79	77	77	77	74	74	74	67
1	74	71	68	66	72	69	67	67	65	63	58
2	68	63	59	56	66	62	58	59	56	54	50
3	62	56	51	47	61	55	51	53	49	46	43
4	57	50	45	41	56	49	44	48	43	40	38
5	53	45	40	36	52	45	39	43	39	35	33
6	49	41	36	32	48	40	35	39	35	31	29
7	46	37	32	28	45	37	32	36	31	28	26
8	43	34	29	25	42	34	29	33	28	25	24
9	40	32	26	23	39	31	26	30	26	23	21
10	38	29	24	21	37	29	24	28	24	21	19

Based on a floor reflectance of 0.2

Avg. Luminance (cd/m²)

Vertical Angle	Hor O	Horizontal Angle 0 45 90						
55	1758	1420	1306					
65	1207	1087	1024					
75	669	761	703					
85	205	411	377					

IES files for this and other photometric options can be downloaded online at www.ledalite.com

Additional Information

Mounting

Integrates with most common T-bar ceiling types.




D1 Standard T-Grid

Option D1 works with 9/16" and 15/16" flat T-grid ceilings. It can also be used with slot T-grid ceilings, but it will not sit flush with the bottom of the T-bar.

Ceiling Types

Integrated mounting tabs can be field-adjusted to various T-bar ceiling heights for fastening directly to the T-bar grid and/or tied-off to the building structure.



Specifications

Due to continuing product improvements, Ledalite reserves the right to change specifications without notice.

Housing

Die-formed, post-painted, 22 gauge cold-rolled steel (New York City version is 20 gauge). Wire entrances are positioned on the side of the housing to allow easy wiring access for the installer. Multiple wire entrances are available on top or side to allow continuous row mounting of fixtures. Optional frame restraint is available to provide additional support to the optical frame.

Weight

Maximum 30 lbs.

Optical System

Optical assembly consists of flat acrylic panels and flat acrylic lens. A protected MesoOptics® film layer creates optimal light distribution and high efficiency. The optical frame ends are constructed from dieformed cold-rolled steel assembled together with extruded aluminum profiles in a sturdy frame. The frame is hinged to allow easy access to the inside of the fixture. Maintenance can be performed from below the ceiling without tools. No hardware is visible.

Mounting

Fixture is compatible with most ceiling types. Integrated bend-out tabs are provided for different T-grid heights. Optional drywall kit is available for non-accessible ceilings. Use screws or hanger wire (supplied by others) to secure fixture.

Ballast

Electronic. Supplied with pre-installed ballast disconnects as per national electric codes.

Wiring

Optional flex whips are supplied in 6' lengths for 1x4, 2x2 and 2x4 fixtures. Flex connectors are supplied in 9' lengths for standard master/satellite configurations.

Air Return

Air return option available in 2'x2' and 2'x4' sizes only. Side rails are finished in black.

Approvals

Certified to UL & CSA Standards.

City of Chicago Approved CCEA (housing option C).

Designed to comply with NYC code requirements (Housing Option N).

Finish

Housing and Frame: Post-painted, high quality powder coat. Available in white only.

© 2010 Ledalite Phone: 604.888.6811 Fax: 800.665.5332 Web: www.ledalite.com Filename 9714xxxxxF128.pdf Rev 2.5